

NOTICE OF COMPLETION


CLASS ENVIRONMENTAL ASSESSMENT (EA)

Commerce Way Transformer Station (TS) and Associated Transmission Line Upgrades

Hydro One Networks Inc. (Hydro One) has completed the Class Environmental Assessment (EA) for a proposed new 115/27.6 kilovolt (kV) transformer station (Commerce Way TS). Hydro One's preferred location for the new transformer station is within the City of Woodstock's Commerce Way business park, as shown on the map below.

To bring electrical supply to the new station, Hydro One is proposing to upgrade the existing single-circuit 115 kV transmission line on the existing transmission right-of-way from Woodstock TS in Southside Park along Parkinson Road to the proposed Commerce Way TS. The line would be rebuilt as a double-circuit line on taller structures with 230 kV capacity, but would initially continue to operate at 115 kV. The Class EA also addresses the potential future need to upgrade the existing 115 kV line between the Commerce Way TS and Toyota Junction, the tap point supplying the Toyota Woodstock TS on Towerline Road in the Township of Norwich.

These new facilities are needed to supply future electricity demand in the Woodstock area. Subject to completion of the Class EA process and receipt of Ontario Energy Board approval, Hydro One is targeting to have the proposed facilities in service by the end of 2011.

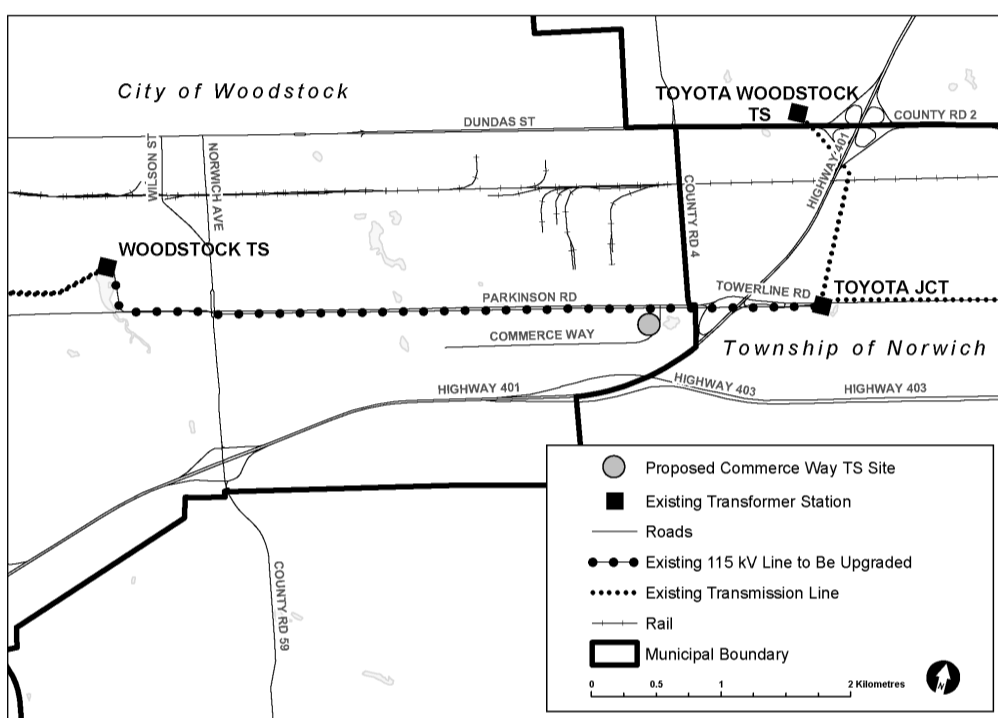

How to Submit Your Input

In accordance with the *Class EA for Minor Transmission Facilities*, the draft Environmental Study Report (ESR) will be available for public review and comment for a 30-day period from Thursday, March 12 to Monday, April 13, 2009. The draft ESR can be viewed at www.HydroOneNetworks.com/newprojects. A copy of the report is also available at the following locations. Please call each location for hours of operation.

Woodstock Hydro

16 Graham Street
Tel: (519) 537 3488

Woodstock Public Library

445 Hunter Street
Tel: (519) 539 4801

City of Woodstock

500 Dundas Street
Tel: (519) 539 1291

Township of Norwich

210 Main Street East, Otterville
Tel: (519) 863 2709

Written questions or comments on the draft ESR must be received no later than 4:30 p.m. on Monday April 13, 2009. Please address correspondence to:

Yu San Ong

Environmental Planner
Hydro One Networks Inc.
483 Bay Street, North Tower, 12th Floor
Toronto, ON M5G 2P5

Tel: (416) 345 5031
Fax: (416) 345 6919
Email: yusan.ong@HydroOne.com

If no concerns are expressed, the ESR will be finalized and filed with the Ministry of Environment (MOE). The project will be considered acceptable and will proceed as outlined in the draft ESR. If questions or comments on the project cannot be resolved by Hydro One during the 30-day review period, the concerned stakeholder(s) may make a written request to the MOE to "bump-up" the project to an Individual EA as outlined in the Part II of the *Ontario Environmental Assessment Act*. Written requests must be received by the Minister no later than 4:30 p.m. on Monday, April 13, 2009 at the following address:

Ministry of the Environment
135 St. Clair Avenue West, 12th Floor
Toronto, ON M4V 1P5

Please note that a duplicate copy of the request must also be sent to Hydro One at the address noted above.

