

1 **DISTRIBUTION BUSINESS LOAD FORECAST AND**
2 **METHODOLOGY**

3
4 **1.0 INTRODUCTION**

5
6 This exhibit discusses Hydro One Distribution's system load forecast and methodology.
7 It provides information on a distribution total basis that assists Hydro One Distribution in
8 forecasting the work programs that need to be undertaken by Hydro One Distribution to
9 meet customers' growing electricity demands, and to accommodate new customer
10 connections.

11
12 Hydro One Distribution uses a number of methods, such as econometric models, end-use
13 models, and customer forecast surveys to produce the forecasts required for its
14 distribution business. Similar methods are used by major utilities throughout North
15 America.

16
17 All forecasts presented in this section are weather-normal, i.e. abnormal weather effects
18 are removed from the base year for load forecasting purposes so that the forecast assumes
19 typical weather conditions based on the average of the last 31 years. The weather
20 correction methodology used by Hydro One Distribution is a proven technique that has
21 performed well in past years. The same methodology was reviewed and approved by the
22 Board in the Distribution Cost Allocation Review (EB-2005-0317) and for Hydro One's
23 2006 Distribution Rate case (RP-2005-0020/EB-2005-0378).

24
25 All forecasts produced are internally consistent. This means that the forecasts for all
26 customer groups add up to the total for the entire customer base served by Hydro One
27 Distribution distribution system. Also, the forecasts presented in this exhibit are

1 consistent with the economic assumptions which are used in the business planning
 2 process and that are described in Exhibit A, Tab 14 Schedule 2.

3
 4 Hydro One Distribution's load forecast staff has significant experience in preparing
 5 provincial and local electricity demand forecasts and load profiles. The methodology
 6 described in this exhibit is similar to Hydro One's 2006 Distribution Rate case (RP-2005-
 7 0020/EB-2005-0378). The performance of Hydro One Distribution's system load
 8 forecast, since Hydro One Distribution's separation from the former Ontario Hydro, has
 9 been fairly consistent as shown in Table 1 below.

10
 11 **Table 1**

12 **Comparison of Hydro One Distribution Forecast with Actual**
 13 **(Variance of forecast expressed as percent of actual on weather corrected basis)**

Forecast made for Plan Year	Variance for Plan Year	Variance for 2 nd Year	Variance for 3 rd Year
1997	0.12	-2.03	1.91
1998	-2.03	-3.39	-2.02
1999	-0.85	0.73	-0.15
2000	0.46	-0.03	0.76
2001	-1.80	-1.56	-2.44
2002	1.98	2.39	2.12
2003	-0.82	-1.37	-0.74
2004	0.14	0.62	0.76
2005	0.25	0.12	n/a
2006	-0.06	n/a	n/a
Mean (1997-2001)	-0.82	-1.26	-0.96
One standard deviation (+/-)	1.13	2.57	3.00
Mean (2002-2006)	0.30	0.04	0.09
One standard deviation (+/-)	1.04	2.38	2.74

34 Note: The forecast performance pertains to Hydro One Retail purchases, which account for about 96
 35 percent of the revenue requirements in the Distribution Rate case. The remaining 4 percent pertains to
 36 revenue attributed to load distributed through the system for about 80 embedded Direct and embedded LDC
 37 customers.

1 Over the 2001-2002 period, Hydro One Distribution has acquired some 164,000
2 customers as part of its acquisition program of embedded LDCs. Therefore for the period
3 leading up to 2002 the comparison of performance reflects a smaller customer base.

4
5 Between 1997-2001, the average variance of customers' energy purchase forecast
6 compared to the weather corrected actual energy consumed is within one standard
7 deviation of the forecast, despite large variances resulting from unusual events such as
8 Ice Storm in 1998 and September 11 in 2001. One standard deviation means there is one
9 in three chances that the actual will be outside the plus or minus range (alternatively,
10 there is two in three chances that the actual will fall within the plus or minus range). The
11 performance of the forecast in subsequent years, namely 2002 to 2006, shows that the
12 forecast is tracking very well and certainly well within one standard deviation band for
13 the corresponding energy purchases. The use of the one standard deviation as a measure
14 of forecasting accuracy is an accepted standard in the utility industry.

15
16 Section 2 below provides more detailed discussion in respect of the various economic
17 considerations that Hydro One Distribution staff take into consideration when applying
18 the methodology for deriving the load forecasts.

19
20 Hydro One Distribution's forecasting methodology comprises a combination of elements
21 that include consensus input, mechanical adjustments to models commonly used in the
22 forecasting business to include changes in economic forecasts, energy prices, population
23 and household trends, industrial development and production, residential and commercial
24 building activities, and efficiency improvement standards. Economic inputs were based
25 on analyses prepared by major economic establishments in the country such as Global
26 Insight, Conference Board of Canada, Centre for Spatial Economics, University of
27 Toronto, Canada Mortgage and Housing Corporation, Clayton Research; efficiency
28 standard assumptions used in the end-use models were based on discussion with Ontario

1 Ministry of Energy staff; specific customer development was based on forecast survey
2 results from major customers. Information provided from these entities is consistent with
3 the economic assumptions used in business planning as described in Exhibit A, Tab 14
4 Schedule 2. Also, inputs from these entities form the economic database (referred to
5 henceforth as economic forecast) that is used to establish Hydro One Distribution load
6 forecast. Section 3 below provides a detailed description of the methodology used by
7 Hydro One to develop its load forecasts. Detailed modeling equations and definitions are
8 presented in the Appendices.

9
10 When applying Hydro One Distribution's forecasting methodology to derive the 2008
11 requirements, Hydro One Distribution is expected to deliver 40,666 GWh of electricity to
12 some 1,170,000 distribution customers. This represents an increase of 0.14 percent over
13 the 2006 demand forecast and an increase of 1.7 percent over the 2006 customer count.
14 Section 4 below provides more detailed discussion in respect of the comparison of the
15 2008 forecast in relation to the historic (2006) and bridge (2007) years. Hydro One
16 Distribution's load forecast has incorporated the Board's latest decision for Hydro One
17 Transmission Rate case (EB-2006-0501) to include 350 MW of natural conservation in
18 the provincial CDM target of 1350 MW for 2007. The load forecast in 2008 also
19 accounts for 251 MW of CDM program impacts assumed in the OPA's IPSP that was
20 filed with the Board on August 29, 2007.


21
22 **2.0 DISCUSSION OF THE ECONOMIC CONSIDERATIONS THAT**
23 **INFLUENCE HYDRO ONE DISTRIBUTION'S LOAD FORECASTS**
24

25 In this section we discuss some of the key economic considerations that must be taken
26 into account in the process of developing load forecasts and in the application of
27 forecasting methodologies. The elements of the forecasting process used by Hydro One
28 Distribution are for the most part based on the knowledge of how the major economic

1 drivers that affect the usage of electricity demand are likely to pan out over the forecast
2 period, which in this case is for the year 2008. Consequently for the purpose of this
3 application the focus is on the short term and the load forecast will reflect those impacts
4 that are likely to have a major effect in this respect. The major economic drivers used in
5 the analysis are summarized in Figure 1 below.

6

Figure 1
Hydro One Distribution Load Forecast Methodology

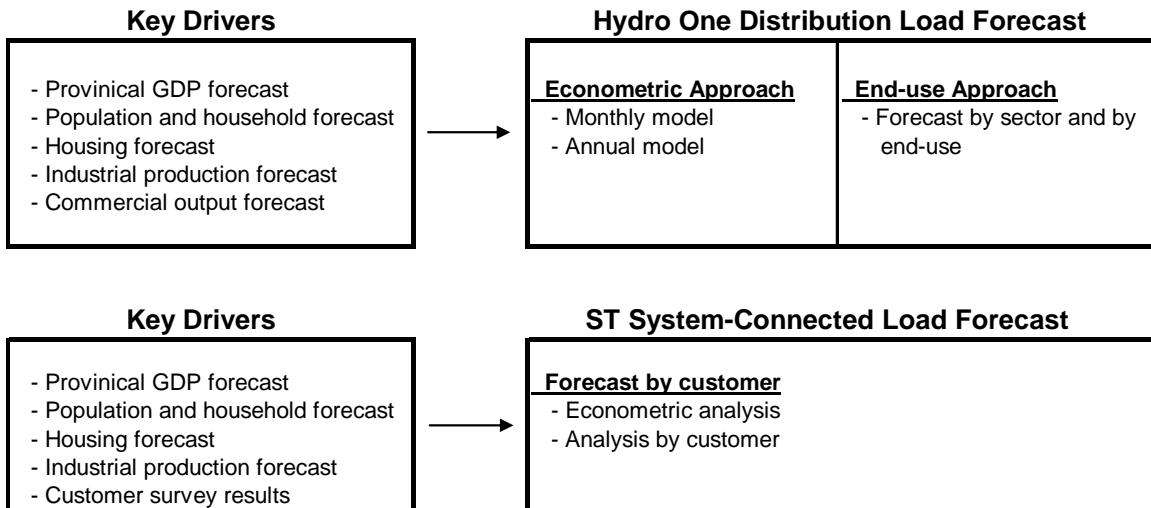

7

8

9 Key information used in the analysis includes the Ontario GDP, provincial demographic,
10 industrial production and commercial output forecasts and regional analysis included in
11 the economic forecast. Also taken into consideration are Hydro One Distribution CDM
12 plans, which have a direct impact on distribution system energy demands.

13

14 The load forecast in support of this application was prepared and released in April 2007
15 using economic information and forecasts that were available in early 2007. The timing
16 of the load forecast is driven by the needs of the business planning process which in turn
17 are geared to match the timeline for this submission.

1 **2.1 Provincial GDP Forecast**

2
3 The provincial GDP forecast is a key driver for the load forecast. During the 1990s, the
4 Ontario economy grew faster than the national economy. During the economic
5 slowdown in 2003 and 2004, the Ontario GDP lagged behind the Canadian GDP because
6 of the SARS outbreak and the Blackout in 2003 and rising Canadian dollars in both years
7 for which the provincial manufacturing sector was the hardest hit. Industries that were
8 negatively affected in recent years include the pulp and paper, chemical and auto-related
9 industries. The provincial economy grew 2.8 percent in 2005 but slowed to 1.3 percent
10 of output growth in 2006 due primarily to the high Canadian dollar and slow US
11 economic growth. Based on the consensus forecast, the Ontario GDP is expected to grow
12 1.7 percent in 2007 and 2.9 percent in 2008. Because of the strong Canadian dollar,
13 Ontario will continue to lag behind the national growth rates.

14
15 **2.2 Provincial Population Forecast**

16
17 Ontario population grew 1.7 percent in 2002, 1.1 percent in each of 2003, 2004 and 2005,
18 and 1.0 percent in 2006. Population growth for the province is forecast to continue to
19 outperform the nation in the forecast period. The economic forecast indicated that
20 Ontario population is expected to grow at 1.2 percent in 2007 and 2008. Steady
21 population growth contributes positively to the load forecast.

22
23 **2.3 Provincial Housing Forecast**

24
25 Helped by relatively low interest rates, demand for housing remained very strong in the
26 last few years. Housing starts statistics showed growth of 84,000 houses in 2002, 86,000
27 houses in 2003, 84,000 houses in 2004, 78,000 in 2005, and 74,000 in 2006. Demand for
28 housing is expected to slow in the next 2 years as interest rates continue rising. The

1 consensus forecast indicated that housing starts will slow to about 67,000 units in 2007
2 and 68,000 units in 2008. This represents about 17 percent decline in housing starts
3 relative to the 2002-2006 period.

4 5 **2.4 Commercial Output Forecast**

6
7 With the help of low interest rates, commercial activities remained strong in Ontario in
8 the last five years, averaging about 3 percent a year. With rising Canadian dollar,
9 commercial output growth is expected to soften from 3.3 percent growth achieved in
10 2006 to 2.3 percent in 2007 and 2.9 percent in 2008. Industries expected to enjoy above-
11 average growth include wholesale and retail trade, financial services and health care
12 services, while tourism-related industries such as accommodations and food services will
13 continue to face some challenging times. Commercial output is important to the load
14 forecast because commercial load comprises about 25 percent of the Hydro One
15 Distribution System.

16 17 **2.5 Industrial Production Forecast**

18
19 After a decline of 1.5 percent in 2006, the manufacturing sector in Ontario is forecast to
20 decline further by 0.4 percent in 2007 due primarily to the impact of higher Canadian
21 dollar. Since early 2003, the Canadian dollar has appreciated by about 40 percent relative
22 to the U.S. dollar. Industries that were hardest hit in the past few years include fabricated
23 metals, paper and printing, chemicals, primary metals, machinery and wood. The
24 economic forecast expects industrial production to grow by about 3.0 percent in 2008.
25 The industrial production forecast is important to the load forecast because industrial
26 activity comprised about 10 percent of total load and also because it is prone to economic
27 cycles.

1 **2.6 Conservation and Demand Management**

2
3 Hydro One Distribution supports the Ontario Government's conservation and demand
4 management (CDM) target to achieve a 1,350 MW of peak reduction by 2007 and a
5 further reduction of 1,350 MW by 2010. Hydro One Distribution used the Board
6 approved 3rd tranche funding of \$39.5 million to cover its CDM programs for the 2004-
7 2007 period. After the 3rd tranche funding, Hydro One will rely on the CDM funding
8 from OPA to fund its CDM initiatives in 2008 and beyond.

9
10 Table 2 summarizes the cumulative CDM impact since 2004 assumed in Hydro One's
11 distribution system load forecast for 2006, 2007 and 2008. The CDM impact includes
12 programs undertaken by Hydro One Networks and programs implemented by other
13 agencies such as federal and provincial governments, OPA and IESO. Hydro One
14 Distribution's 2007 CDM impact is the same as the 2007 CDM impact approved by the
15 Board for Hydro One's Transmission Rate case (EB-2006-0501) issued on August 16,
16 2007. A 350 MW reduction to the 2007 provincial CDM target of 1350 MW was made
17 to account for the impact of natural conservation. The 2008 CDM impact is consistent
18 with the OPA's IPSP filed with the Board on August 29, 2007.

19
Table 2

**CDM Impact on Hydro One Distribution Load
(GWh)**

Year	Hydro One Retail	Embedded Direct and LDC Customers	Total
2006	194	151	345
2007	311	242	554
2008	437	333	770

1 CDM programs that have been undertaken in the past two years or are in the process of
2 being initiated include the following initiatives:

- 3
- 4 • improved building codes for new housing and more stringent efficiency standards
5 for appliances;
- 6 • conservation programs to encourage more efficient use of lighting and appliances;
- 7 • demand response programs to reduce air conditioning and water heating load in the
8 summer months;
- 9 • use of smart metering and TOU rates to encourage consumers to shift consumption
10 patterns to off-peak period; and
- 11 • programs to increase supply or reduce demand such as fuel switching, using back-
12 up generation or requesting large industrial customers to reduce consumption on a
13 temporary basis.
- 14

15 The 2006 annual report filed by Hydro One Distribution on CDM (RP-2004-0203/EB-
16 2005-0198) includes detailed program impacts on a bottom-up basis.

17
18 Hydro One Distribution does not currently have the data required to do a bottom-up
19 analysis of the CDM impact on Hydro One's load forecast from the various CDM
20 programs driven by various sources such as the Ontario Power Authority, Provincial
21 Government and Federal Government.

22 23 **2.7 Customer Forecast**

24
25 In 2007 Hydro One Distribution is expected to serve about 1.17 million customers
26 through its distribution system. Detailed customer information is retained in the
27 Customer Settlement System (CSS) for billing and account management. Customer data
28 are extracted from CSS regularly for tracking, analysis and reporting. Customer forecast

1 was developed on an as-required basis to support the annual business planning process,
2 system development plans and rate submissions to the Board. Active customer accounts
3 and service points are used as the basis from which to prepare the customer forecast by
4 rate class. The customer forecast takes into consideration the new customers requiring
5 distribution services, existing customers moving out, provincial housing demand,
6 population and household forecasts, vacancy rates and specific growth patterns of various
7 customer groups.

8
9 Approximately nine to ten thousand customers are added to Hydro One Distribution's
10 customer base on an annual basis. Customer growth in 2007 and 2008 is expected to be
11 approximately 11,000 and 9,400 respectively (2007 customer growth includes an addition
12 of 1,100 customers from Terrace Bay). This compares to an average of about 12,000
13 customers that were added per year in the period 2002-2006. The lower figure for 2008
14 is attributed to a reduction in housing starts.

15 16 **3.0 LOAD FORECASTING METHODOLOGY**

17
18 Hydro One Distribution system's load forecast is developed using both econometric and
19 end-use approaches. The forecast base-year is corrected for abnormal weather conditions
20 and the forecast growth rates are applied to the normalized base-year value. Thus the
21 forecast is weather-normal in the sense that it predicts the future load under normal
22 weather conditions.

23 24 **3.1 Weather Correction Analysis**

25
26 This section discusses the weather correction methodology used by Hydro One Distribution.
27 Weather correction analysis removes the abnormal or extreme weather effects from the load
28 data to yield average conditions that reflect the more normal or expected weather that is

1 used in the forecast. It is essential that abnormal and extreme weather related impacts are
2 removed before establishing the base-case load data, on which basis the load forecast will be
3 developed. The volatility of abnormal or extreme weather conditions would likely adversely
4 impact on the ability to provide a consistent and meaningful forecast for load growth.
5 Hourly load data and hourly weather data of various weather stations across the province are
6 used in the analysis.

7

8 Hydro One Distribution's weather correction methodology was developed jointly by
9 forecasting and meteorology staff of the former Ontario Hydro. This weather correction
10 method was used to forecast the total system load since 1988 and for forecasting local
11 electric utility load since 1994. The weather correction methodology used by Hydro One
12 Distribution is a proven technique that has performed well in the past years. The same
13 methodology was reviewed and approved by the Board in the Distribution Cost
14 Allocation Review (EB-2005-0378) and for Hydro One's 2006 Distribution Rate case
15 (RP-2005-0020/EB-2005-0378).

16

17 Weather correction is a statistical process designed to remove the impact of abnormal or
18 extreme weather conditions from historical load data. Normal weather data is defined to
19 be data that is based on the average weather conditions experienced over the last 31
20 years. A weather-normal load forecast is a forecast of load assuming normal weather
21 conditions with a weather-corrected base year. As shown in Table 3, using a fewer
22 number of years for historic weather normalization has only a small impact on the total
23 weather corrected energy consumption. This is an expected outcome since weather
24 normalization has a more significant impact on peak than it does on energy due to the fact
25 that energy consumption is less sensitive to short-term weather conditions.

Table 3

Comparison of Different Time Periods Used for Weather Normalization (in GWh)

Number of Years Used to Calculate Normal Weather	Actual Load for Hydro One Retail Customers in 2006	Weather Correction Required for Hydro One Retail Customers in 2006	Weather Corrected Load for Hydro One Retail Customers in 2006
Last 31 Years *	22485	437	22921
Last 20 Years	22485	367	22852
Last 10 Years	22485	308	22792
Last 5 Years	22485	404	22889

* Used by Hydro One Distribution to normalize the base year (2006) load.

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20

Hydro One Distribution’s weather correction methodology uses four years of daily load and weather data to establish a sound statistical relationship between weather and load at the applicable transformer station or delivery point used to supply customer demand. Weather variables used in the analysis include temperature, wind speed, cloud cover and humidity. The estimated weather effects are then aggregated up to the required time interval. Past experience shows that weather correction should best be done on a daily basis, rather than weekly, monthly or annual basis.

Daily weather-correction is preferred because the timing of extreme temperatures combined with wind speed and humidity can have a substantial impact on load that would otherwise not be captured by averages over longer period of time. In particular, when abnormal weather conditions continue for several days, the cumulative impact is much greater than would be the case if the same weather conditions prevailed over a much longer period of time.

The loads that are most impacted by changes in weather conditions are electric space heating and cooling in residential and commercial buildings. Across Ontario, the penetration rate of such loads varies widely, which means the weather sensitivity of load

1 supplied from one transformer station or delivery point may differ quite significantly from
2 that of load supplied from another transformer station or delivery point, even in the same
3 climate zone. The climate in Ontario varies considerably from the Niagara Peninsula to
4 Thunder Bay, so it is important to use data from the appropriate weather stations that are in
5 close proximity to the transformer station or the customer delivery point when correcting for
6 weather effects.

7 8 **3.2 Hydro One Distribution Forecasting Methodology**

9
10 Both econometric (top-down) and end-use (bottom-up) models are used to prepare load
11 forecast for Hydro One Distribution. Both monthly and annual econometric models are
12 used to forecast Hydro One Distribution's total distribution system load. End-use models
13 using the results from the provincial end-use models are used to analyse the distribution
14 system load by customer rate class (i.e. various residential and general service
15 customers). Key information used in the analysis includes economic, demographic,
16 industrial production and commercial output forecast provided in the economic forecast.
17 The purpose of using both the econometric and end-use forecast models is to arrive at a
18 balanced forecast that represents a consistent set when looked at from macro
19 (econometric) and micro (end-use) perspectives.

20 21 Monthly Econometric Model

22 The monthly econometric model uses a multivariate time series approach to develop the
23 monthly forecast for the Distribution system load. The model links monthly energy
24 consumption to Ontario GDP and residential building permits. Appendix 1 provides the
25 detailed regression equations and definitions.

1 Annual Econometric Model

2 The annual econometric model uses personal disposable income per household, relative
3 energy price and cooling and heating degree-days to prepare the forecast. Appendix 2
4 provides the detailed regression equations and definitions.

5

6 End-Use Model

7 The end-use models cover the residential (year round and seasonal), commercial, industrial
8 and agricultural sectors. Detailed equations of the end-use models are provided in
9 Appendix 3.

10

11 The above models are used to prepare forecast for all existing and proposed rate classes:

12 **Existing Rate Classes**

13 Year Round Residential Customers

- 14 • Residential continuous use, high density (R1);
15 • Residential continuous use, normal density (R2);
16 • Residential continuous use, urban density (UR);
17 • Residential customer from acquired LDC's (Res);

18

19 Seasonal Residential Customers

- 20 • Residential seasonal use, high density (R3);
21 • Residential seasonal use, normal density (R4);

22

23 Agricultural Customers

- 24 • Farm customers
25 • Farm service, continuous use, normal density, single phase (F1);
26 • Farm service, continuous use, normal density, three phase (F3);
27 • General service and sub-transmission customers

1

2 General Service Industrial and Commercial Sectors

- 3 • General distribution supply, single phase (G1);
- 4 • General distribution supply, urban, (UG);
- 5 • General distribution supply, three phase (G3);
- 6 • General sub-transmission supply (T);
- 7 • General service customers from acquired LDC's (GS)
- 8 • Large general service customers from acquired LDC's (MLGS);
- 9 • Streetlight.

10

11 **Proposed Rate Classes**

- 12 • Urban residential
- 13 • Residential, high density
- 14 • Residential, normal density
- 15 • Seasonal
- 16 • General service, energy-billed
- 17 • General service, demand-billed
- 18 • Urban general service, energy-billed
- 19 • Urban general service, demand-billed
- 20 • Sub-transmission
- 21 • Street lighting
- 22 • Sentinel lighting
- 23 • Distributed generation

1 **3.3 Methodology for Low Voltage System-Connected Customers**

2
3 This section discusses the load forecasting methodology used for the analysis of Low
4 Voltage (LV) system connected customers. These are the embedded customers who are
5 directly connected to Hydro One's sub-transmission (ST) system or have a delivery point
6 embedded in Hydro One's distribution service territory and include distribution utilities,
7 industrial and commercial customers. Both econometric and customer analysis based on
8 survey results from the customers, when available, are used in the forecast. This is
9 supplemented by the economic data provided in the economic forecast.

10
11 In 2007, Hydro One Distribution conducted a customer load forecast survey with the
12 embedded distribution utilities and embedded industrial customers with more than 5 MW
13 of loads. In addition to questions relating to the total load of the customer, information at
14 each of the delivery point was also collected. The customer survey results are used in
15 preparing the customer forecast.

16
17 For embedded distribution utility customers, econometric analysis is used to prepare the
18 load forecast as a group. For industrial customers, several information sources are used
19 to prepare the forecast. These include:

- 20
- 21 • historical load profile of the customer,
 - 22 • knowledge of the customer through industry monitoring,
 - 23 • forecast provided by customer through the survey,
 - 24 • company information through Hydro One Distribution account executives, industry
25 and company forecasts from industry associations and government agencies, and
 - 26 • production and industry forecasts provided in the economic forecast.
- 27

1 The econometric approach was used to forecast the load for embedded utilities and
2 industrial analysis was used to forecast the load for the embedded industrial customers.
3 In both cases, results from customer survey, when available, were taken into account in
4 developing the forecast.

6 **3.4 Methodology for Hourly Load Profiles**

7
8 This section discusses the methodology for generating the hourly load profiles by
9 customer class and for specific customer delivery points.

11 Hourly Load Shape by Customer Class

12
13 Hydro One Load Research team was the project lead undertaking joint load research
14 work on behalf of the Ontario Load Data Research Group consisting of about 45 LDCs in
15 the province. The load research methodology to collect new hourly load data for
16 developing the generic load shapes by customer rate class was examined in detail by the
17 Distribution Cost Allocation Working Group and was approved by the Board in RP-
18 2003-0228 and EB-2005-0317.

19
20 The province-wide generic load shapes was prepared by the Hydro One Load Research
21 team under the guidance of Professor Dean Mountain of McMaster University. Hydro
22 One Load Research team subsequently used the generic load shapes to generate utility-
23 specific load profiles for about 80 LDCs in Ontario, including Hydro One Distribution,
24 for their cost allocation review filings under proceeding EB-2005-0317. Appendix 4
25 summarizes the methodology used by Hydro One Load Research team to weather-
26 normalize the total utility load and for each rate class. Appendix 5 summarizes the
27 methodology used to prepare the utility-specific load shapes using the generic load

1 shapes. Hydro One Distribution used the above methodology to prepare hourly load
2 shapes for all rate classes.

3

4 Hourly Load Shape by Customer Delivery Point

5

6 Electricity Power Research Institute (EPRI)'s Hourly Electric Load Model (HELM) is
7 used to normalize the hourly load for each of the customer delivery points, taking out
8 abnormal weather effects and load patterns. The customer forecast is used to drive the
9 customer delivery point forecast. Key information used in the analysis includes hourly
10 load and weather data.

11

12 The most updated customer totalization table is used to retrieve hourly electricity demand
13 data for each of the customer delivery points connected to the ST system. The
14 totalization table reflects the latest records from Hydro One Networks. For each
15 customer delivery point, at least one full year of hourly data is retrieved and checked for
16 data quality. Hourly weather data is also retrieved to prepare weather sensitivity analysis.
17 Weather data analyzed include temperature, wind speed, cloud cover and humidity. Data
18 for five weather stations across Ontario are used in the analysis. They include Toronto,
19 Windsor, Ottawa, North Bay and Thunder Bay. Each delivery point is linked to the
20 closest weather station.

21

22 In preparing the database for the load shape analysis, missing values are estimated by
23 load on a similar day and hour during the same month. For weather-sensitive load,
24 weather conditions are also taken into account in estimating the missing values. To
25 perform the latter task, an hourly regression model (relating load to weather conditions)
26 for each delivery point with missing values is developed.

1 EPRI's HELM is used to prepare the hourly weather response analysis by each delivery
2 point. The model takes into account differences in load depending upon time of use (that
3 is weekdays, weekends and holidays) and weather conditions. Load of industrial
4 customers is assumed to be insensitive to weather and as such are forecast in relation to
5 load on a similar day and hour during the historical period.

6 7 **4.0 2008 LOAD FORECAST**

8
9 Hydro One Distribution' distribution system is forecast to deliver in total 40, 666 GWh in
10 2008 on a weather-normal basis. Table 4 presents the load forecast before and after
11 deducting the impact of CDM.

12
13 Before deducting the impact of CDM, Hydro One Distribution's load forecast is forecast
14 to grow from 40, 955 GWh in 2006 to 41,046 GWh in 2007 and to 41,436 GWh in 2008
15 on a weather-normal basis. The forecast reflects slow economic growth in 2007 and
16 particularly weak performance from the industrial customers and overall stronger
17 economic growth in 2008.

18
19 In 2008, Hydro One Distribution is expected to serve about 1,170,000 customers. This
20 reflects about 1.7 percent growth in the number of customers compared to 2006.

21
22 After removing the impact of CDM, Hydro One Distribution's load is forecast to
23 decrease from 40, 609 GWh in 2006 to 40,493 GWh in 2007 and increase to 40,666 GWh
24 in 2008 on a weather-normal basis.

25

Table 4

**Hydro One Distribution Load Forecast Before and After CDM Impact
 (GWh)**

Year	Retail Customers	Embedded Customers	Total
<u>Load Forecast Before Deducting Impact of CDM</u>			
2006	23,115	17,839	40,955
2007	23,256	17,790	41,046
2008	23,494	17,942	41,436
Annual Growth Rates			
2007	0.61	-0.27	0.22
2008	1.02	0.85	0.95
2006-2008	0.81	0.29	0.59
<u>Load Impact of CDM</u>			
2006	194	151	345
2007	311	242	554
2008	437	333	770
<u>Load Forecast After Deducting Impact of CDM</u>			
2006	22,921	17,688	40,609
2007	22,944	17,548	40,493
2008	23,057	17,609	40,666
Growth Rates			
2007	0.10	-0.79	-0.29
2008	0.49	0.35	0.43
2006-2008	0.30	-0.22	0.07

1 Note: All figures are weather normal and 2006 values after deduction of CDM ;

2

3 Since the forecast is weather-normal; the actual load could be below or above the forecast
 4 depending on the weather conditions and/or a different economic growth pattern. Table 5
 5 presents the upper and lower bands of one standard deviation for the Hydro One
 6 Distribution system load forecast. Based on historical data, there is a two in three chance
 7 that the actual in 2008 will fall within the upper and lower bands. The bands are derived

1 using Monte Carlo simulation technique relating variations in load to variations in
2 Ontario GDP and weather.

3
4 **Table 5**

5
6 **One Standard Deviation Uncertainty Bands for Hydro One Distribution Load**
7 **(GWh)**

8

9 Year	Lower Band	Forecast	Upper Band
10			
11			
12 2007	39,789	40,493	41,175
13 2008	39,827	40,666	41,520
14			

1 **Appendix 1: Monthly Econometric Model**

2
3 The monthly econometric model uses the State-Space approach in the regression equation,
4 where the left-hand side of the equation represents the energy estimates, and the right-hand
5 side contains the explanatory variables including the dummy variables that are used to
6 capture special events that could affect the energy estimates because these events would
7 likely cause variations in the load. The dummy variables are used to minimize the
8 variability of the energy estimates around the forecast.

9
10
$$\text{LRTLTL} = f(\text{LGDPONT}, \text{LBPONT}, \text{D98Jan})$$

11 where:

12 LRTLTL = logarithm of Distribution load,

13 LGDPONT = logarithm of Ontario GDP in constant 1997 dollars,

14 LBPONT = logarithm of Ontario residential building permits in constant dollar,

15 D98Jan = dummy variable to account for the load impact of 1998 Ice Storm, equals 1 in
16 January 1998 and zero elsewhere,

17
18 The output parameters from the model are presented below. The State-Space (SS) estimated
19 parameters are not associated with standard error and t-ratios (statistical relevance test).

20
21

<u>Seasonal Factors</u>	State-Space (SS) <u>parameters:</u>
A[1]	-0.134796
K[1]	-0.568914

25

<u>Non-Seasonal Factors</u>	<u>SS parameters:</u>
A[1]	0.531829
K[1]	-0.345868
GDPONT[-4]	0.0784784
BPONT[-9]	0.00440215
D98JAN	-0.0150467

33

34 R-squared = 0.989, R-squared corrected for mean = 0.989, Durbin-Watson Statistics = 2.31.

1 The goodness of fit, or the extent to which variability in the energy estimates is captured in
2 the forecast, is measured in terms of R-squared (adjusted for mean), which in this case is
3 close to 1. This result reflects statistical significance of the explanatory variables that are
4 used to explain for the variations in load. In fact, the results show that in this case the fit is
5 very good, and therefore there is confidence that the forecast will produce outcomes that are
6 within the expected range of variability.

7
8 Using the forecast values for GDP, building permits and dummy variables, the above
9 parameters are used in the monthly regression equation described on the previous page to
10 generate the forecast for Hydro One Distribution load.

Appendix 2: Annual Econometric Model

Annual econometric model uses personal disposable income per household, relative energy price and cooling and heating degree-days to prepare the forecast. The annual model is expressed in the following regression equation:

$$\begin{aligned} \text{LRTL} = & C(1) + C(2) * \text{LYDPHH} + C(3) * (\text{LPELRES}(-1) - \text{LPGASRES}(-1)) \\ & + C(4) * \text{LCDD} + C(5) * \text{LHDD} + C(6) * \text{LRTL}(-1) - C(4) * C(6) * \text{LCDD}(-1) - C(5) \\ & * C(6) * \text{LHDD}(-1) + C(7) * \text{D99A} + C(8) * \text{TR} + C(9) * \text{TR}^2 \end{aligned}$$

where:

- LRTL = logarithm of Distribution load,
- LYDPHH = logarithm of Ontario personal disposable income per household in constant \$,
- LPELRES = logarithm of electricity price for Ontario residential sector,
- LPGASRES = logarithm of natural gas price for Ontario residential sector,
- LCDD = logarithm of cooling degree days for Pearson International Airport,
- LHDD = logarithm of heating degree days for Pearson International Airport,
- D99A = dummy variable to account for annexation of retail customers by municipal utilities equals 1 after 1999 and zero elsewhere,
- TR = a dummy variable to account for a shift in growth pattern of Distribution load, increases by 1 per year prior to 1989 and no increase afterwards,
- TR² = TR to power 2,
- C(1) – C(9) = variable coefficients.

The estimated coefficients and associated statistics are presented below.

	<u>Estimated</u>	<u>Standard</u>	
	<u>Coefficient</u>	<u>Error</u>	<u>t-ratio</u>
C(1)	5.548910	1.273869	4.355949
C(2)	0.303905	0.119354	2.546245
C(3)	-0.055342	0.025059	-2.208471
C(4)	0.004952	0.007168	0.690828
C(5)	0.195571	0.043265	4.520272
C(6)	0.286776	0.103890	2.760383
C(7)	-0.020994	0.007506	-2.796974
C(8)	-0.100598	0.023221	-4.332256
C(9)	0.002619	0.000546	4.795182

R-squared = 0.995, Adjusted R-squared = 0.993, Durbin-Watson Statistic = 1.90.

1 Similar to the regression analysis in the case of the Monthly Econometric model above, the
2 goodness of fit, measured by (Adjusted) R-square for the Annual Econometric Model, is
3 also found to be close to 1. Therefore the assessment on an annual basis also leads to a
4 forecast outcome which provides consistent results, thus giving confidence to the
5 econometric method. The t-ratios show most of the factors used to explain the variations in
6 load are statistically significant.

7

8 Using the forecast values for personal disposable income, energy prices, cooling and heating
9 degree days and dummy variables, the above parameters are used in the annual regression
10 equation described on the previous page to generate the forecast for Hydro One Distribution
11 load.

1 **Appendix 3: End-Use Model**

2
3 The following briefly describes the methodology used in the end-use model.

4
5 Residential Sector

6 The residential energy forecast is determined by forecasting the number of accounts times
7 appliance saturation rates and unit energy consumption expressed in the following equation:

8
$$USE_{Res} = \sum_i \sum_j N_{i,j} * S_{i,j} * UEC_{i,j}$$

9 Where

- 10 • USE_{Res} is residential energy consumption
11 • N is the number of residential accounts
12 • S is the residential appliance saturation rate
13 • UEC is the unit energy consumption per end use
14 • I is the index for appliances (space heating, space cooling, water heater and base
15 load)
16 • J is the index for customer types—year-round residential customers and seasonal
17 residential customers

18
19 The following section describes each component of the equation in detail.

- 20 • The base-year number of households is taken from Hydro One Distribution billing
21 system. The forecast in the growth of the number of residential accounts is based on a
22 forecast of housing starts. The number of residential accounts is the current number of
23 residential accounts plus the forecast of net additional accounts to be added each year.
24 • The base-year end-use shares (space heating, water heating and air conditioning), and
25 fuel switching (space/water heating) information are based on Hydro One Residential
26 Appliance Survey conducted in 2005 for year-round and seasonal customers.

- 1 • The trends for end-use shares and fuel switching over the forecasting period reflect the
2 provincial trends from the Hydro One provincial residential end-use model, as well as
3 information specific to Hydro One Distribution.
- 4 • The base-year end-use UEC's are based on the provincial residential end-use model with
5 adjustments for heating degree days, cooling degree days, income, household size,
6 square footage and household vintage.

7

8 Commercial Sector

9 The commercial energy forecast is based on the following equation:

10 $USEcom = USEcom(-1) * (1 + \text{Expected annual growth rate})$

11

12 Where

- 13 • *USEcom* is the commercial energy consumption for the forecast year
- 14 • *USEcom(-1)* is the commercial energy consumption for the previous year. The base
15 year (2006) consumption is taken from the latest Hydro One Distribution billing
16 system corrected for abnormal weather effects
- 17 • Expected annual growth rates are based on the Hydro One provincial commercial
18 end-use model. Where appropriate, the values are adjusted to reflect specific
19 distribution business characteristics.
- 20 • The model uses an end-use framework to provide estimates of energy use by
21 building type. The building types include multi-residential, office, elementary and
22 secondary school, college and universities, health, public service, retail, grocery,
23 accommodation, recreation, religious/cultural, warehouse, commercial
24 miscellaneous. non-building related segments and streetlight.

25

1 Industrial Sector

2
3 The industrial energy forecast is based on the following equation:

4 $USE_{ind} = USE_{ind}(-1) * (1 + \text{Expected annual growth rate})$

5
6 Where

- 7 • USE_{ind} is the industrial energy consumption for the forecast year
- 8 • $USE_{ind}(-1)$ is the industrial energy consumption for the previous year. The base year
9 (2006) consumption is taken from the latest Hydro One Distribution billing system
10 corrected for abnormal weather effects
- 11 • Expected annual growth rates are based on the Hydro One provincial industrial end-
12 use model. Where appropriate, the values are adjusted to reflect specific distribution
13 business characteristics.
- 14 • The model uses an end-use framework to provide estimates of energy use by industrial
15 segments including Fishing, logging, Forestry Service, Mining, Petroleum, Food and
16 Beverage, Tobacco, Rubber and Plastic, Textile and Clothing, Wood and Furniture,
17 Paper and Printing, Primary Metal, Fabricated Metal Products, Transportation
18 Equipment, Electronics etc.

19
20 Agricultural Sector

21 The Agricultural sector forecast is based on the following equation:

22 $USE_{agri} = USE_{agri}(-1) * (1 + \text{Expected annual growth rate})$

23 Where

- 24 • USE_{agri} is the agricultural energy consumption for the forecast year
- 25 • $USE_{agri}(-1)$ is the agricultural energy consumption for the previous year. The base
26 year (2006) consumption is taken from the latest Hydro One Distribution billing system
27 corrected for abnormal weather effects

- 1 • Expected annual growth rates are based on the Hydro One provincial agricultural end-
2 use model. Where appropriate, the values are adjusted to reflect specific distribution
3 business characteristics.
- 4 • The model uses an end-use framework to provide estimates of energy use by
5 agricultural segments including Animal Production, Fruit and Vegetable Farming,
6 Grain Farming, Green Housing and Floriculture and Miscellaneous etc.

1 **Appendix 4: Weather Normalization for Total Utility Load and by Rate Class**

2
3 Weather Normalization for Total Utility Load

4
5 Hydro One's weather normalization methodology for total utility load is summarized as
6 follows.

- 7
- 8 • An equation relating daily energy and daily weather conditions is developed using the
9 latest 4 years of data. This time frame allows the analysis to reflect the most recent
10 load mix while having sufficient data to quantify its weather sensitivity. For
11 example, the share of space cooling energy relative to total energy has increased
12 rapidly over the past decade; using too long a time series of historical data may lead
13 to significant under-estimation of the weather sensitivity of load in the summer.
 - 14
15 • To better isolate the impact of weather, systematic changes in daily loads are
16 identified and filtered out before the regression analysis begins. The systematic
17 effects removed include growth trends, cyclical variations, day-of-the-week effects
18 and holiday effects. The objective is to filter the data to weather-related load and
19 noise (random effect).
 - 20
21 • Different types of weather data are used in the analysis. For winter loads, weather
22 data include temperature, wind speed and cloud opacity. For summer loads, weather
23 data include temperature, humidity and cloud opacity. Because weather effects
24 cumulate over several days, the temperatures for the current day as well as the
25 previous 3 or 4 days are also used as explanatory variables in the model. The
26 relationship between energy and weather may be represented by the following
27 function:
- 28

1 Weather- Related Energy = f (Weather Conditions) + Random Term (1)

2

3 where the random term reflects any remaining variations that are not explained
4 systematically by weather. The random term is assumed to be distributed
5 independently, identically and normally with mean equals to zero.

6

- 7 • The coefficients from Equation (1) are estimated using the most recent 4 years of
8 daily load and weather data. These coefficients indicate the sensitivity of load in the
9 service territory relative to today’s temperature, yesterday’s temperature and all other
10 weather variables included in the equation. The estimated coefficients are multiplied
11 by the actual weather data for the corresponding weather variable in the equation to
12 determine the estimated weather-related energy for the day. This process is repeated
13 for each day of the period for which weather-correction is performed.

14

15 Estimated Weather-Related Energy = f (Actual Weather Conditions and Estimated
16 Coefficients) (2)

17

- 18 • Equation (2) is used to determine what “normal” weather-related loads would be for
19 each day of the year given the current mix of weather-sensitive loads in that service
20 territory. This is done by running the equation with each of the last 31 years of daily
21 weather data for that day plus the seven days on either side of it. The average of the
22 estimated weather-related loads for the 15 days times 31 years (465 observations) is
23 deemed to be the “normal” weather-related energy for that day. Using 31 years of
24 weather history is considered adequate to approximate normal weather.

25

26 Normal Weather-Related Energy (for each day) = Average (31 years of Estimated
27 Weather-Related Energy for that Day +/- 7 Days) 3)

28

- 1 • On a daily basis, the weather correction is derived as the difference between the
2 estimated and normal weather- related energy:

3
4 Weather Correction for Energy = Normal Weather-Related Energy – Estimated
5 Weather-Related Energy (4)

- 6
7 • Weather-corrected energy is defined to be actual energy plus the weather correction
8 in any given period. For any period that is more than one day (e.g., a month), the
9 total weather correction is the sum of the daily weather correction.

10
11 Weather-Corrected Energy = Actual Energy + Weather Correction for Energy (5)

- 12
13 • For example, a summer day for which the combination of temperature and humidity
14 are above normal yields a negative weather correction. The weather correction in this
15 case should be viewed as the amount to be subtracted from the above normal actual to
16 get the weather-corrected energy. Similarly, a warm winter day would have a
17 positive weather correction as the weather corrected value for that day should be
18 higher than the below normal actual.

19
20 Weather Normalization by Rate Class

21
22 Weather correction by rate class is derived from weather correction for the total utility
23 using the electric space heating and cooling shares by rate class or segment as detailed
24 below.

- 25
26 • Weather correction for the total utility load is discussed above using daily energy for
27 the utility. The amount of weather correction is measured on a daily basis.

- 1 • Using average daily temperature for each day, the daily weather correction is grouped
2 into “weather correction for space heating” and “weather correction for space
3 cooling”. For example, if average daily temperature is -1, the weather correction for
4 that day is allocated to “weather correction for space heating” load. The daily
5 weather correction results are aggregated into annual or monthly weather correction
6 estimates.
- 7
- 8 • Using load shape analysis and residential appliance saturation estimates for the utility
9 and the region, the amount of space heating and cooling load over a year or month are
10 estimated for each rate class. The weather correction for each rate class is calculated
11 using the space cooling and heating load of that rate class. The methodology used is
12 summarized as follows.
- 13
- 14 • **Residential cooling/heating load:** Residential load shapes are developed using the
15 generic load shapes (cooling, space heating, electric water heating, etc.) from the
16 Ontario Load Data Research Group. Based on these generic load shapes and specific
17 appliance saturation estimates for the utility and the region, total residential space
18 heating and cooling load are calculated. The generic load shapes may vary by region,
19 reflecting different weather conditions across the province.
- 20
- 21 • **Non-residential cooling/heating load:** For non-residential rate classes, the generic
22 load shapes from the Ontario Load Data Research Group (or available load shapes
23 from Hydro One for load shapes not covered by the joint load research project) are
24 used to calculate the cooling and heating load percentages by rate-class or segment
25 (e.g., by SIC or industry segment). Again, these generic load shapes may vary by
26 region, reflecting different weather conditions across the province. Some industrial
27 segments may not be weather-sensitive; in this case the space heating and cooling
28 loads would be zero. The corresponding percentages of space cooling and heating

1 load multiplied by rate-class or segment load would provide the cooling and heating
2 load of that rate class or segment.

3

4 • **Total cooling/heating load and shares:** Total space heating and cooling load for the
5 utility are calculated by adding residential and non-residential space heating and
6 cooling loads from above. Using this total, the shares of cooling and heating load for
7 each rate class relative to the total cooling and heating load are calculated.

8

9 • **Weather correction by rate-class:** For each rate class, the cooling and heating
10 weather correction amount are calculated using the total cooling and heating weather
11 correction amount for the utility multiplied by the corresponding cooling and heating
12 shares calculated from above. Shares of some industrial segments could be zero since
13 they are not weather sensitive. The weather-corrected load for each rate class is
14 estimated by adding the weather correction estimates by rate class to the
15 corresponding (actual) load for each rate class.

1 **Appendix 5: Methodology for Preparing Utility-Specific Load Shapes**

2
3 Hydro One's method makes use of the following information:

- 4
- 5 • Generic load shapes prepared for the Ontario Load Data Research Group for
6 residential and general service customers.
 - 7 ○ The residential load shapes have weather-normal profiles for 4 end-use categories
8 (electric space heating, electric water heating, air conditioning and base load) and
9 4 regions (Central, East, West and North).
 - 10 ○ The general service customer load shapes have load profiles for about 35 industry
11 segments using NAICS-2002 (North American Industry Classification Systems)
12 and by number of working shifts.
 - 13 • Hydro One weather normalization methodology for total utility load and by rate class.
 - 14 ○ Hydro One weather normalization method, which was approved by the Board in
15 RP-2005-0020/EB-2005-0378 and EB-2005-0317, uses 4 years of daily load and
16 weather data to establish the relationship between weather and load and the
17 average of 31 years of weather data to define typical weather conditions.
 - 18 ○ Weather variables used in the weather correction analysis include temperature,
19 wind speed, cloud cover and humidity. In addition to temperature, wind speed is
20 important in the winter months, while humidity is important for the summer
21 months.
 - 22 ○ Estimation of space heating and cooling loads for residential customers makes use
23 of generic load shapes and appliance saturation estimates.
 - 24 ○ Estimation of space heating and cooling loads for general service customers
25 makes use generic load shapes and industry classification.
 - 26 • Weather-normalized load shapes for battery mats prepared by the Hydro One Load
27 Research team using information provided by the local cable company. For the
28 informational filing to OEB, weather-sensitive load profiles for battery mats are

1 required only for LDCs using future test year and not required for LDCs using
2 historic test year in their 2006 EDR applications.

- 3 • Results of residential appliance survey undertaken by LDCs using survey questions
4 recommended by the OEB's load research expert. For LDCs opted not to undertake
5 residential appliance survey, estimates of appliance saturation are prepared using
6 monthly energy patterns for each residential customer.
- 7 • Deemed street lighting and sentinel lighting load profiles approved by the OEB.
- 8 • Interval meter customer load profiles by rate class and by industry classification.
- 9 • Special tabulation of Household Equipment Survey results from Statistics Canada.
- 10 • Residential appliance survey results undertaken by former Ontario Hydro.

11

12 Hydro One's utility-specific load shape methodology is summarized as follows:

13

14 Weather correction analysis

15

- 16 • Weather correction analysis is performed for each region and LDC.
- 17 • For each region, weather correction analysis is undertaken using the total regional
18 load.
- 19 • For each LDC, the weather correction analysis is undertaken for the total utility load
20 as well as by rate class. Weather sensitive loads for space heating and space cooling
21 are determined for each day.
- 22 • The relationship of weather sensitivity between the region and the LDC is used to
23 calibrate the utility-specific space heating and cooling loads with the regional
24 estimates.
- 25 • Using the weather correction analysis, generic load shapes and monthly profiles,
26 weather-corrected loads are estimated for the total utility load and by rate class.

27

1 Residential Customers

- 2
- 3 • Using number of customers, appliance saturation and generic load profiles, the energy
4 consumption by end-use are estimated.
 - 5 • The relationship of weather sensitivity between the region and the LDC is used to
6 calibrate the utility-specific energy consumption for space heating and cooling loads.
 - 7 • The relationship of appliance saturation and housing characteristics between the
8 region and the LDC is used to calibrate the utility-specific profiles for water heating
9 and base loads.
 - 10 • Weather-normal hourly load shapes are estimated using generic load shapes and
11 energy consumption by end-use.
 - 12 • Weather-normal energy consumption by end-use will add up to weather-normal
13 residential rate class total.

14

15 General Service >50 KW Customers

- 16
- 17 • General service >50 kW customers are grouped by industry classification excluding
18 interval metered customers.
 - 19 • Allocation of weather correction is undertaken for industry classifications that are
20 weather sensitive.
 - 21 • Analysis takes into consideration number of work shifts for each industry
22 classification.
 - 23 • Weather-normal hourly load shapes are estimated using generic load shapes and
24 energy consumption for each industry classification.
 - 25 • Weather-normal energy consumption by industry classification will add up to
26 weather-normal general service >50 kW rate class total.