

**NOTES:**

1. IF GROUNDING DOES NOT ALREADY EXIST WHEN CONTRACTOR PLACES CABLES, THEN IT SHALL BE INSTALLED BY CONTRACTOR.
2. RADIUS MUST BE GREATER THAN THE SPECIFIED CABLE MINIMUM BENDING RADIUS. LEAVE SOME SLACK TO ALLOW FOR GROUND SETTLEMENT.
3. TYPICAL TRANSITION SHOWN IS FOR TEMPORARY SUPPORT AND PROTECTION OF CABLE ABOVE AND BELOW GRADE. FULL TRANSITION TO BE COMPLETED PER APPLICABLE SECTION 5 TRANSITION DRAWING.
4. FOR APPLICABLE CONDUIT (STRAIGHT OR FLEXIBLE), STRAP, GUARD, SWEEP, CAP, AND COUPLE KIT (IF REQUIRED) SEE APPLICABLE TRANSITION DRAWING IN SECTION 5.

ALL DIMENSIONS IN CENTIMETRES UNLESS OTHERWISE STATED

01	SEPT 2023	ORIGINAL DU-03-213-0500-R3 IS NOW SUPERSEDED BY THIS NEW DRAWING/REVISION. CHANGED TO SECTION 5. GENERAL UPDATES TO ALIGN WITH CONTINUOUS CONDUIT SYSTEM & DIRECT BURIED TRANSITION PIT. ADDED NOTES 3 & 4. CHANGED TO NEW DWG. & NUMBERING FORMAT. DIRECT BURIED CONTENT WAS MOVED TO NEW SECTION 15 - DU-146-0500 R01.	PC	MM	MM	MM
			dwn	ckd	des	app
Rev No.	Date	Revision Particulars				

Drawn By: PC	Checked By: M.MATEVSKI	Designed By: M.MATEVSKI	Design Approved By: M.MATEVSKI P.Eng.
Scale: N.T.S.	Date: (yyyy/mm/dd) 2021/10/05	Pole ID:	


**hydro one** Hydro One Networks Inc.

© Copyright Hydro One Networks Inc. All rights reserved. This drawing may not be reproduced or copied, in whole or in part, in any printed, mechanical, electronic, film, or other distribution and storage media or used in any information storage or retrieval system outside of Hydro One Networks Inc., without the written consent of Hydro One Networks Inc.  
Information contained in this drawing is considered to be confidential. Recipients shall only use the drawing for its intended purpose and shall take necessary measures to prevent disclosure or transmittal to outside parties.

Title: TEMPORARY TERMINATION OF UNDERGROUND CABLE BY CONTRACTOR FOR FUTURE CONNECTION TO HYDRO ONE OVERHEAD LINE

Drawing No. DU5-310-0500	Rev. No. 01
-----------------------------	----------------

TITLE BLOCK REV 02 - AUGUST 2014

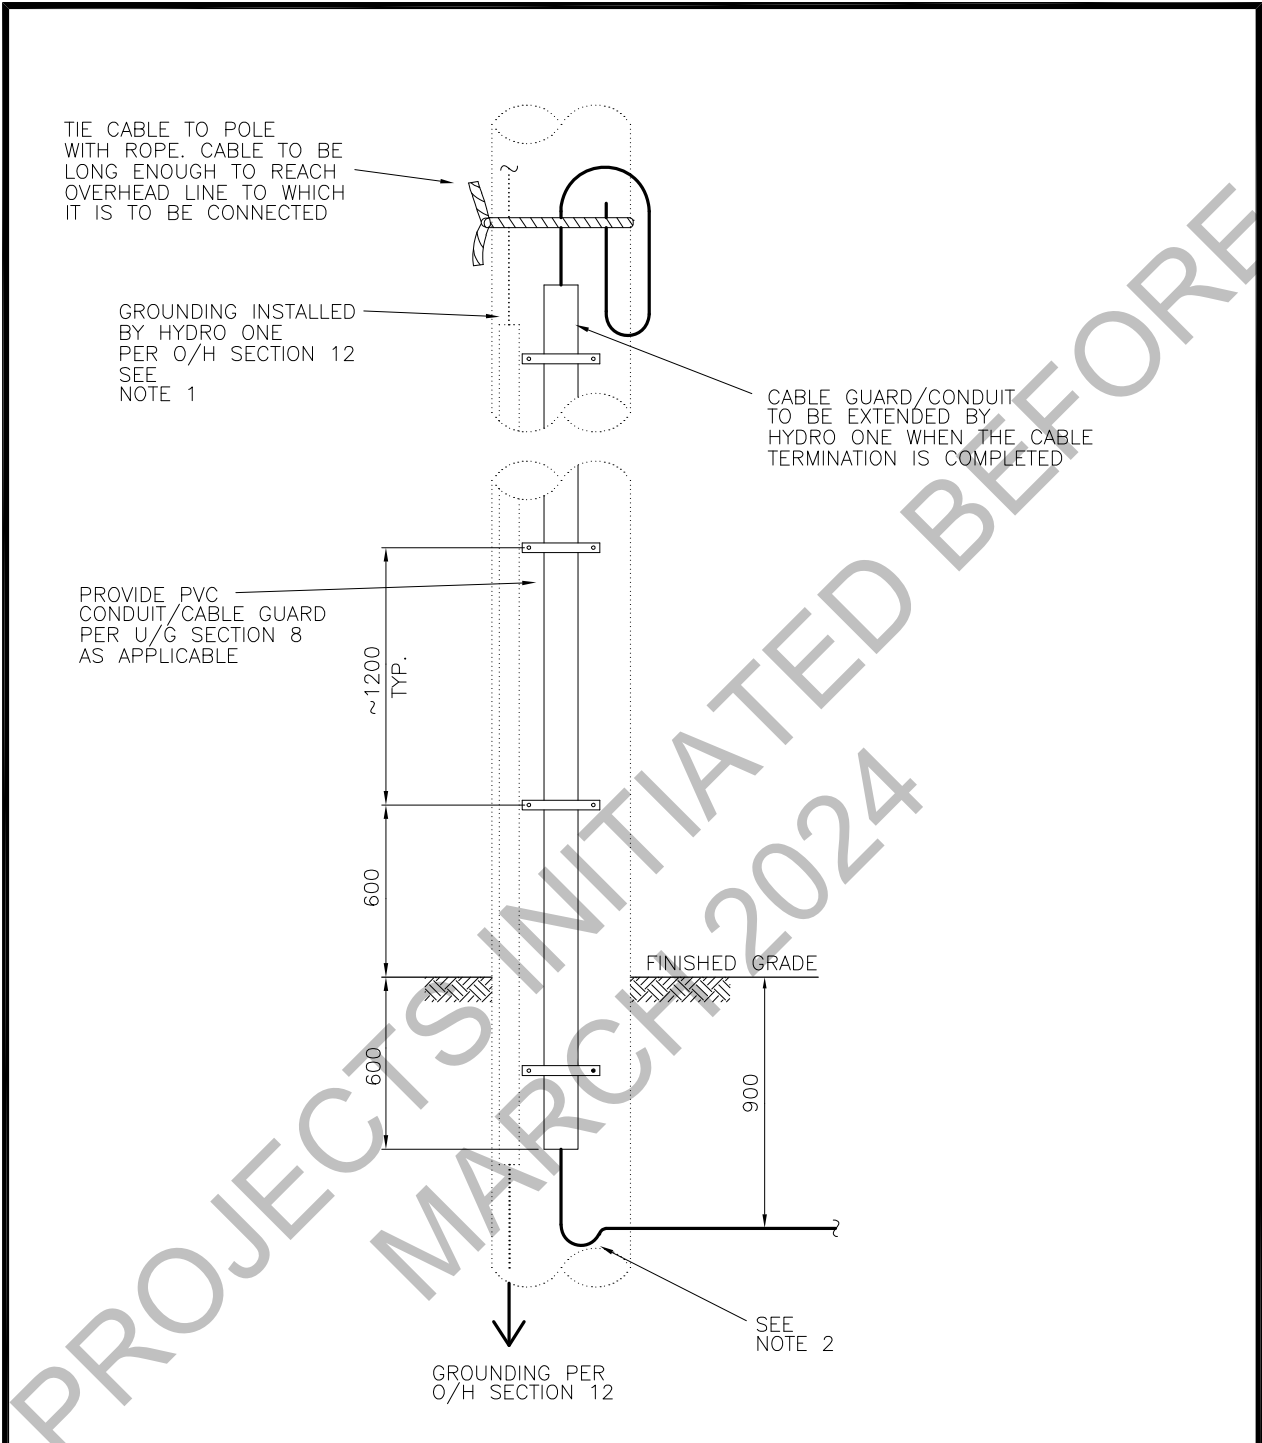

**NOTES:**

1. IF GROUNDING DOES NOT ALREADY EXIST WHEN CONTRACTOR PLACES CABLES, THEN IT SHALL BE INSTALLED BY CONTRACTOR.
2. RADIUS MUST BE GREATER THAN THE SPECIFIED CABLE MINIMUM BENDING RADIUS. LEAVE SOME SLACK TO ALLOW FOR GROUND SETTLEMENT.

ALL DIMENSIONS IN MILLIMETERS UNLESS OTHERWISE STATED

Rev No.	Date	Revision Particulars	dwn	ckd	des	app
03	SEP 2018	GENERAL UPDATES. REMOVED GROUND ROD DETAILS AND NOTE EDITS. CHANGED TO NEW DWG. & NUMBERING FORMAT. FOR PREVIOUS REVISIONS REFER TO DU-03-213-R2.	SO	PC	AS	PS
02	NOV 2011	DELETED CADWELDING & PARTS LIST	SO			

Drawn By: S.O.	Checked By:	Designed By:	Design Approved By: D.THOMPSON
Scale: N.T.S.	Date: (yyyy/mm/dd) 2011/11/04	Pole ID:	

**hydro one** **Hydro One Networks Inc.**

Title: **TEMPORARY TERMINATION OF UNDERGROUND CABLE BY CONTRACTOR FOR FUTURE CONNECTION TO HYDRO ONE OVERHEAD LINE**

© Copyright Hydro One Networks Inc. All rights reserved. This drawing may not be reproduced or copied, in whole or in part, in any printed, mechanical, electronic, film, or other distribution and storage media or used in any information storage or retrieval system outside of Hydro One Networks Inc., without the written consent of Hydro One Networks Inc. Information contained in this drawing is considered to be confidential. Recipients shall only use the drawing for its intended purpose and shall take necessary measures to prevent disclosure or transmittal to outside parties.

Drawing No. <b>DU-03-213-0500</b>	Rev. No. <b>03</b>
--------------------------------------	-----------------------

TITLE BLOCK REV 02 – AUGUST 2014