


NOTES:

1. EXCAVATION ZONE LIMITS ARE ONLY APPLICABLE FOR CLASS 1 TO 5 (NORMAL OR BETTER) SOIL CONDITIONS. FOR CLASS 6 TO 8 (POOR OR SWAMP) SOIL CONDITIONS, CONTACT HYDRO ONE BEFORE BEGINNING ANY WORK.
2. MAXIMUM ALLOWABLE WIND SPEED FOR EXCAVATION IS 40km/h. IF THE WIND SPEED IS GREATER, COVER TRENCHES AND WORK SHALL BE HALTED IMMEDIATELY UNTIL THE SPEED HAS DECREASED.
3. FOR ANY EXCAVATION REQUIRED WITHIN THE UNDISTURBED SOIL ZONE, HYDRO ONE SHALL BE CONTACTED PRIOR TO ANY COMMENCEMENT OF SUCH EXCAVATION TO SUBMIT A 'HOLD THE POLE' REQUEST.
4. THE TRENCH EXCAVATION ZONE AROUND THE POLE BASE IS ONLY ALLOWED WHEN THERE ARE SIX(6) WIRES OR LESS ON THE POLE. IF THE POLE CONTAINS MORE THAN SIX(6) WIRES, CONTACT HYDRO ONE BEFORE BEGINNING ANY WORK.
5. THE TRENCH EXCAVATION ZONE IS ALLOWABLE FOR ONE(1) TRENCH AT A TIME. THE MAXIMUM ALLOWABLE WIDTH WILL BE 50cm AND BE AT LEAST 60cm AWAY FROM THE POLE. THE ONLY ALLOWED ALIGNMENT SHALL BE STRAIGHT WITH NO CURVES OR BENDS ACROSS UNDISTURBED SOIL ZONE. THE TRENCH SHALL BE RESTORED TO ORIGINAL CONDITION AFTER EXCAVATION HAS BEEN COMPLETED.
6. IF AT ANY TIME IN THE COURSE OF EXCAVATION THE POLE APPEARS TO BECOME UNSTABLE TO ANY DEGREE, WORK SHALL BE HALTED IMMEDIATELY AND HYDRO ONE SHALL BE CONTACTED BEFORE PROCEEDING WITH ANY ADDITIONAL EXCAVATION.
7. IF THE SPECIFIED CLEARANCES CANNOT BE MET, CONTACT HYDRO ONE BEFORE BEGINNING ANY WORK.

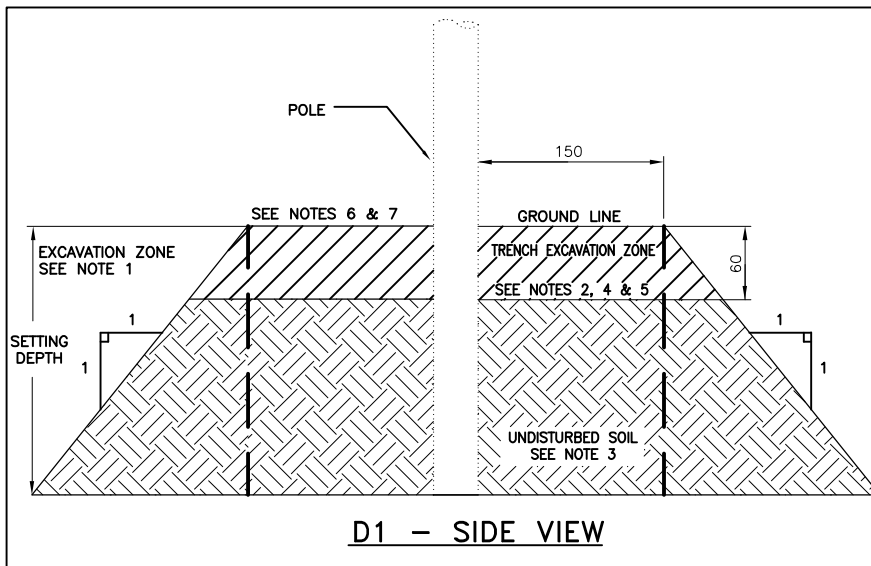

ALL DIMENSIONS ARE IN CENTIMETRES UNLESS STATED OTHERWISE

Rev No.	Date	Revision Particulars	dwn	ckd	des	app	Drawn By: PC	Checked By: S.JASSAL	Designed By: S.JASSAL	Design Approved By: D.DEROSIERS
							Scale: N.T.S.	Date: (yyyy/mm/dd) 2019/06/21	Pole ID:	
							Title: 3rd PARTY EXCAVATION ZONE LIMITS AROUND UNGUYED POLE LOCATIONS			
© Copyright Hydro One Networks Inc. All rights reserved. This drawing may not be reproduced or copied, in whole or in part, in any printed, mechanical, electronic, film, or other distribution and storage media or used in any information storage or retrieval system outside of Hydro One Networks Inc., without the written consent of Hydro One Networks Inc. Information contained in this drawing is considered to be confidential. Recipients shall only use the drawing for its intended purpose and shall take necessary measures to prevent disclosure or transmittal to outside parties.							Drawing No. DL6-201-0500		Rev. No. 00	

TITLE BLOCK REV 02 – AUGUST 2014