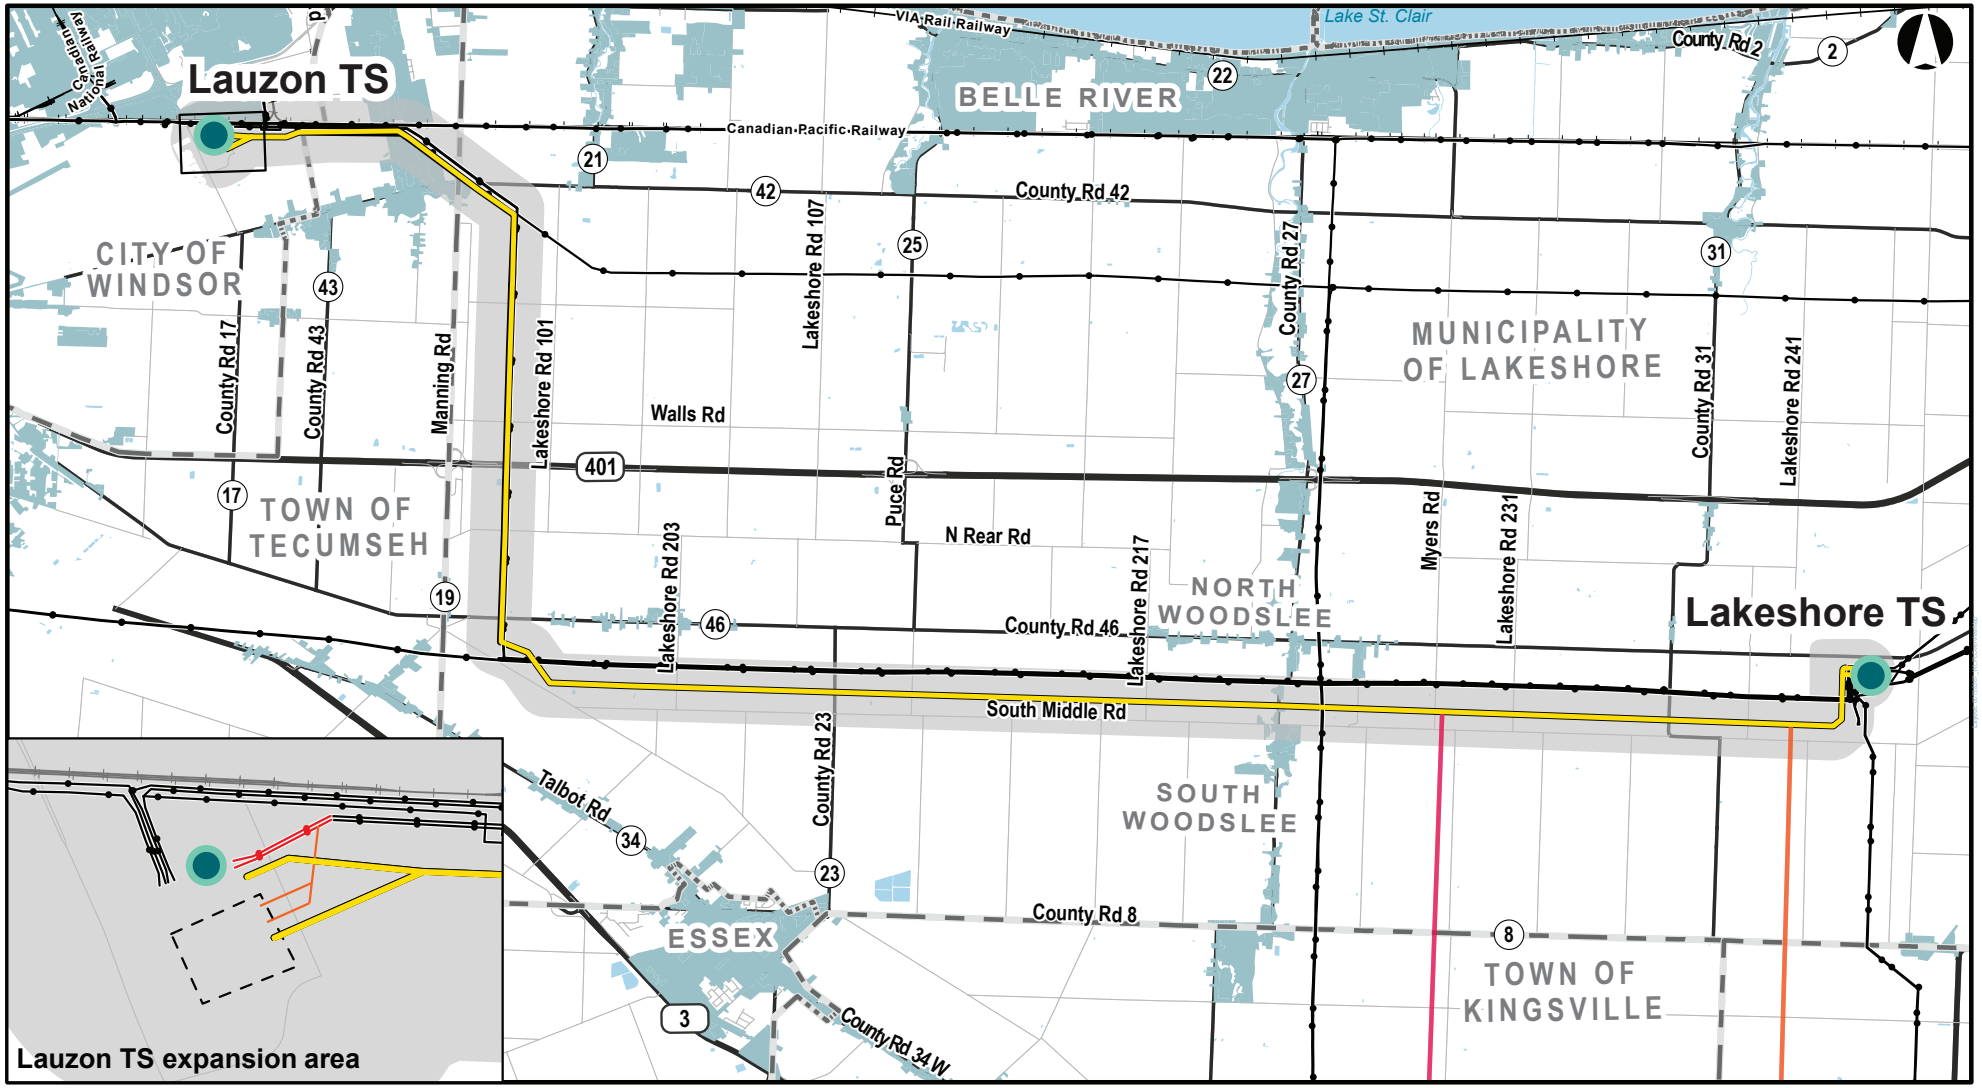


Windsor Lakeshore Power Line project (WLPL)

0 1 2 4 km

WLPL Preferred Route
Route 2A has a proposed right-of-way (ROW) of 46 m, up to 23 m on either side of the centreline

- Preferred Route 2A centreline
- Relocation of 230 kV centreline
- Transformer Station (TS)

Energize Essex County Project connection into WLPL

- Proposed route alternative 1
- Proposed route alternative 2

General features

- Local study area (500 m on either side of the route)
- Existing transmission lines
- Existing transmission lines to be relocated
- Built up area
- Primary, Kings or 400 series highway
- County, regional or municipal road
- Local roads
- Railway
- Waterbody