

## Hydro One Networks Inc. has applied for leave to reconstruct a section of existing transmission line in the City of London

Hydro One Networks Inc. (Hydro One) has applied to the Ontario Energy Board (OEB) for an order granting leave to reconstruct a section of an existing 230 kV single-circuit transmission line between Buchanan Transformer Station and Old Victoria Road Junction within the City of London (M31W Project). The length of the transmission line facilities is approximately 4 kilometres and the forecast total capital cost is approximately \$15.4 million.

You can view the application by visiting [www.oeb.ca/notice](http://www.oeb.ca/notice) and using file number **EB-2026-0003**. A map of the proposed route for the M31W Project is provided below.

Hydro One says the proposed M31W Project is needed to maintain supply to the London Area, as outlined in the Independent Electricity System Operator (IESO) bulk planning report for Central-West Ontario.

Hydro One says that the existing transmission corridor would provide sufficient width for the proposed M31W Project and that no new permanent land rights would be required. Hydro One would also require temporary off-corridor access to facilitate construction of the M31W Project. Hydro One is asking the OEB to approve the forms of agreement it would offer to landowners for the temporary use of their land.

Hydro One says the expected rate impact associated with the M31W Project is a \$0.09 / kW / month decrease in the network pool rate and a 0.09% decrease on the overall average Ontario residential customer's electricity bill.


The IESO's Final System Impact Assessment concludes that the M31W Project is expected to have no material adverse impact on the reliability of the integrated power system.

Hydro One has completed a Final Customer Impact Assessment and has confirmed that the proposed project can be incorporated without adverse impact on Hydro One Transmission customers.

## REQUEST FOR NO HEARING

Hydro One says that the M31W Project will not adversely affect customers in any material way and has requested that the application be decided without a hearing. If you believe a hearing is needed, you can request one by filing a letter with the OEB no later than **March 10, 2026**. You should indicate whether you have a preference for the hearing to be oral, electronic or written. If you do not file a letter by the due date, you may not receive any further notice in the event the OEB proceeds with a hearing. If you submit a letter, your name and the content of your letter will be put on the public record and the OEB website.

**M31W Project Route Map**

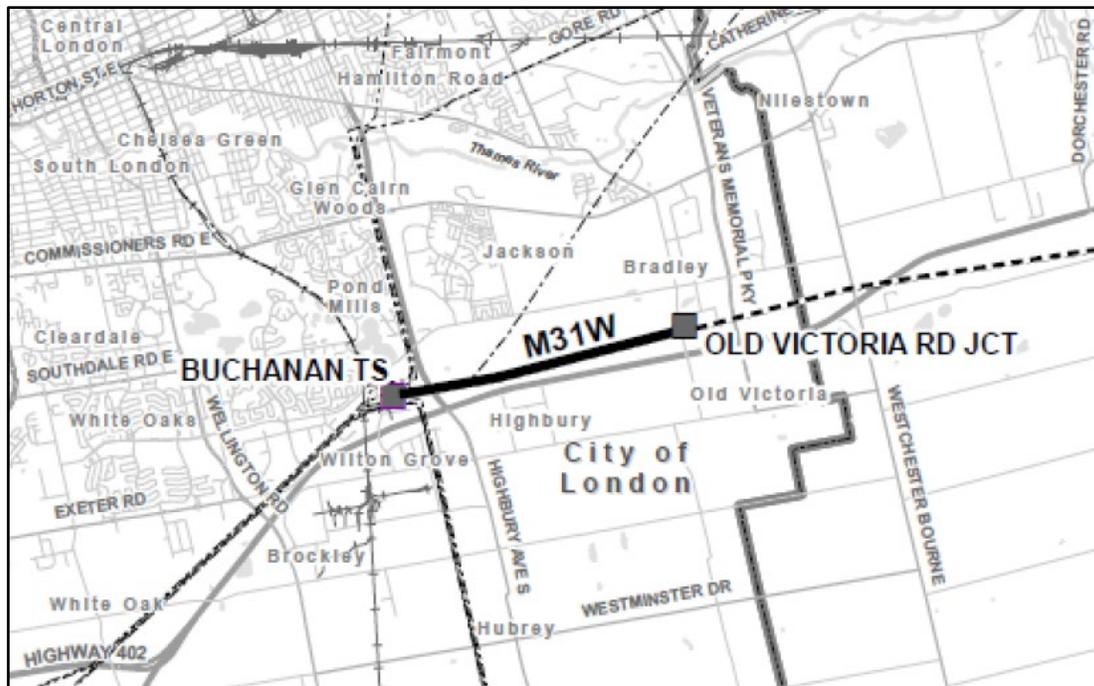

## LEARN MORE

### Ontario Energy Board

📞 1-877-632-2727 TTY: 1-877-632-2727

🕒 Monday - Friday 8:30 AM - 5:00 PM

🌐 [oeb.ca/participate](https://oeb.ca/participate)

### Hydro One Networks Inc.

📞 1 888-664-9376

🕒 Monday - Friday 7:30 AM - 8:00 PM

🌐 [hydroone.com](https://hydroone.com)

This application was made under sections 92, 97 and 21(4) of the *Ontario Energy Board Act, 1998*.

Ce document est aussi disponible en français.



Ontario  
Energy  
Board