


PICTURES 2, 3 & 4
 INSTALLATION VIEWED FROM A MINIMUM OF TWO OPPOSITE ANGLES VERIFYING ALL FOUR INSTALLED GROUND ELECTRODES

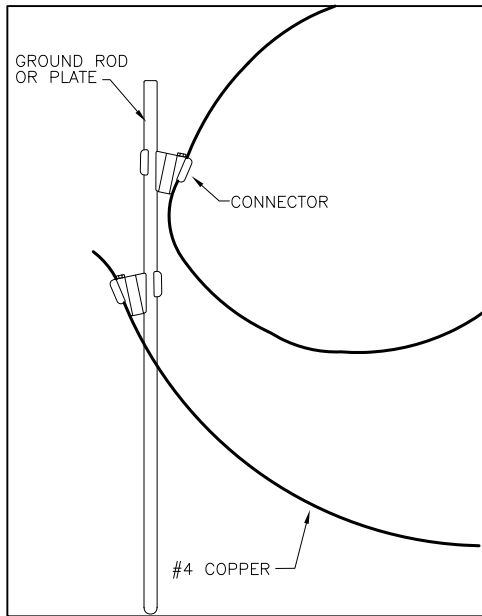

PICTURE 1
 MATERIAL VERIFICATION
 GROUND ROD OR PLATE, CONNECTORS AND WIRE

NOTES:

- EQUIPMENT GROUNDING SYSTEM MUST BE CONSTRUCTED TO HYDRO ONE STANDARDS AND HYDRO ONE INSPECTED PRIOR TO BACKFILLING. TO FACILITATE REMOTE INSPECTION, PLEASE PROVIDE MINIMUM OF FOUR PICTURES TO THE HYDRO ONE REPRESENTATIVE LISTED ON YOUR CONNECTION PACKAGE.
- HYDRO ONE GROUND INSTALLATION DRAWING DU-14-101 WILL BE SUPPLIED WITH YOUR CONNECTION PACKAGE AND IS AVAILABLE ALONG WITH ALL APPROVED MATERIALS ON THE HYDRO ONE WEBSITE AT:
<https://www.hydroone.com/business-services/builders-and-contractors###Forms>
- FAILURE TO INSTALL PER THE HYDRO ONE STANDARDS USING HYDRO ONE APPROVED MATERIALS MAY RESULT IN LENGTHY CONNECTION DELAYS. CONSULT YOUR HYDRO ONE REPRESENTATIVE WITH ANY QUESTIONS.

01		SEPT 2020	REVISED NOTES	PC	KS	KS	Drawn By: PC	Checked By: D.DESROSIERS	Designed By: D.DESROSIERS	Design Approved By: D.DESROSIERS	
Rev No.	Date	Revision Particulars			dwn	ckd	des	app	Scale: N.T.S.	Date: (yyyy/mm/da) 2019/03/27	Pole ID:
© Copyright Hydro One Networks Inc. All rights reserved. This drawing may not be reproduced or copied, in whole or in part, in any printed, mechanical, electronic, film, or other distribution and storage media or used in any information storage or retrieval system outside of Hydro One Networks Inc., without the written consent of Hydro One Networks Inc. Information contained in this drawing is considered to be confidential. Recipients shall only use the drawing for its intended purpose and shall take necessary measures to prevent disclosure or transmittal to outside parties.											
PICTURES REQUIRED FOR GROUNDING GRID APPROVAL								Drawing No.		Rev. No.	
GROUNDING GRID								01			