

PRIMARY DL5-106-0500 FIG.1
OR
SUBTRANSMISSION DL5-107-0500

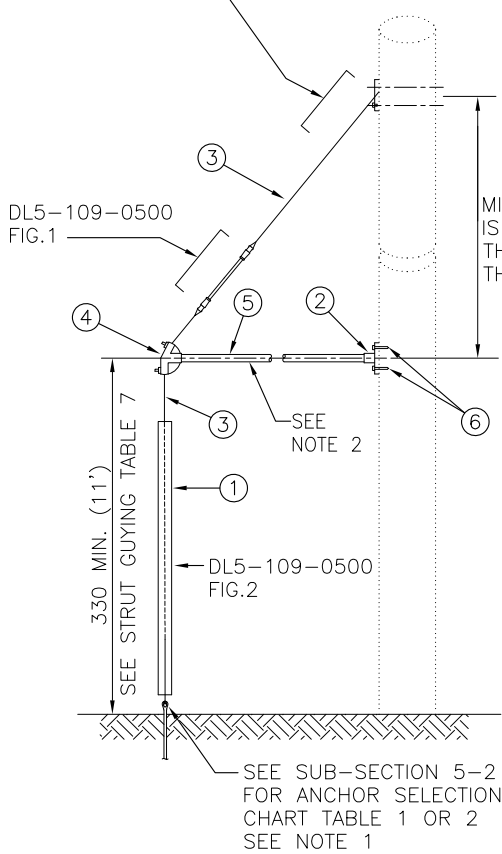


FIG.1
1 GUY WIRE

DIRECTION OF UNBALANCED STRAIN OR RESULTANT LINE TENSION

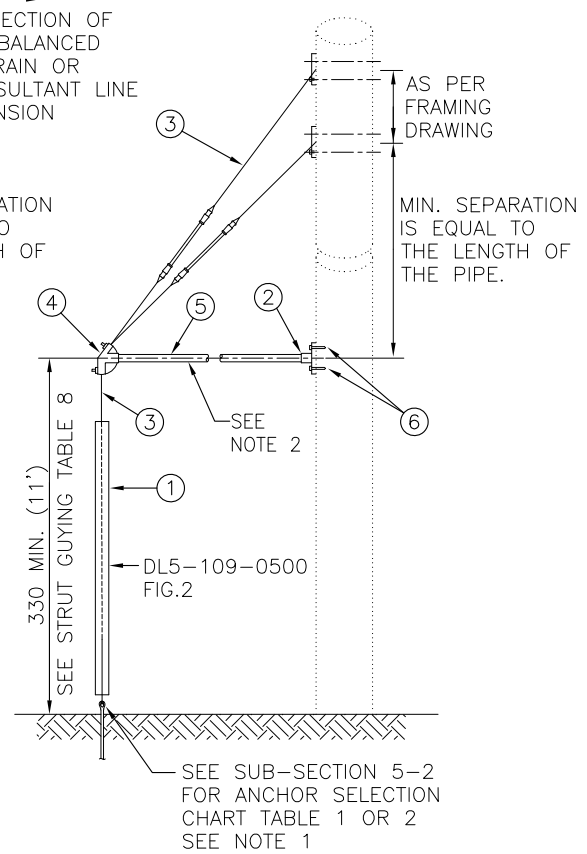


FIG.2
2 GUY WIRES

NOTES:

- ROCK ANCHOR SHOWN IN DL5-207-0500, DL5-208-0500 AND DL5-209-0500 MUST NOT BE USED IN THIS INSTALLATION.
- LENGTH OF PIPE TO SUIT MAX. 3.8m (12'-6") AS PER RELEVANT TABLE IN TEXT SECTION.

PARTS LIST

PART No.	MM No.	DESCRIPTION	QTY.	
			FIG.1	FIG.2
1	30000819	GUARD, GUY	1	1
2	30000734	POLE FLANGE	1	1
3	30002885	GUY WIRE, 9mm	A/R	A/R
4	30000735	GUY STRUT CLAMP	1	1
5	30016060	PIPE, STEEL	1	1
6	30001755	SCREW, LAG, HEX HEAD	2	2

MM# = REFER TO SECTION 16 ONLY A/R = AS REQUIRED

ALL DIMENSIONS IN CENTIMETRES UNLESS OTHERWISE STATED

03	OCT 2022	UPDATING THE REFERENCES OF OLD DRAWINGS TO THE LATEST DRAWINGS.	PC	MM	SP	MM
02	JUL 2021	GENERAL UPDATES. CHANGED TO NEW DWG. & NUMBERING FORMAT. ADDED FIGURE NUMBERS. UPDATED PARTS LIST. FOR PREVIOUS REVISIONS REFER TO DL5-103-R1.	GJ	PC	SS	MM
Rev No.	Date	Revision Particulars	dwn	ckd	des	app

Drawn By: BA	Checked By:	Designed By:	Design Approved By:
Scale:	Date: (yyyy/mm/dd)	Pole ID:	
*			



© Copyright Hydro One Networks Inc. All rights reserved. This drawing may not be reproduced or copied, in whole or in part, in any printed, mechanical, electronic, film, or other distribution and storage media or used in any information storage or retrieval system outside of Hydro One Networks Inc., without the written consent of Hydro One Networks Inc. Information contained in this drawing is considered to be confidential. Recipients shall only use the drawing for its intended purpose and shall take necessary measures to prevent disclosure or transmittal to outside parties.

Title: STRUT GUY	Drawing No. DL5-103-0500	Rev. No. 03
---------------------	-----------------------------	----------------

TITLE BLOCK REV 02 - AUGUST 2014